


1. Applications and Features

Purpose	Gap adjustment of plumbing
Location	Low pressure fan coil, Water supply and hot water piping, Equipment piping, etc.
Features	<p>Unique tube structure provides excellent flexibility.</p> <p>The tube material stainless steel 316L is used as standard for superior corrosion resistance.</p> <p>Ring seat inserted inside the nut prevents twisting of the tube during tightening. Nut type at both ends.</p>

2. Structure and Parts

Figure 1 shows the structure, and Table 1 shows the part names and materials.

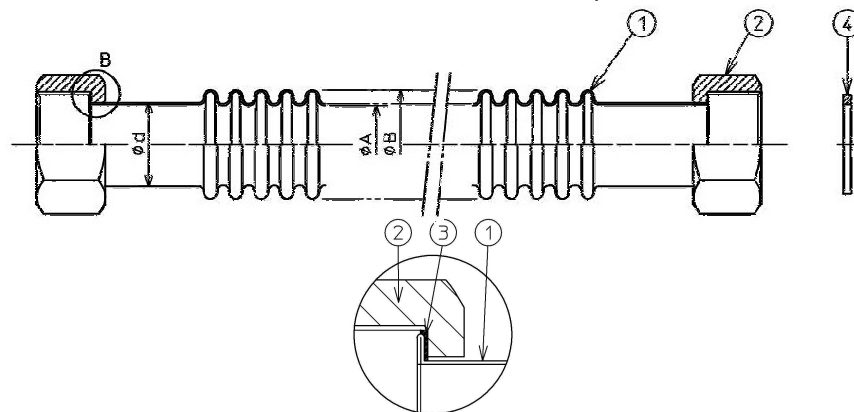

15A~32A Details B

Figure 1 . Structure

Table1. Parts List

No.	Name	Material (Option)
1	Tube	Stainless steel 316L
2	Nut	Brass (Bronze ,Stainless steel 304)
3	Ring sheet	PTFE
4	Gasket	Joint sheet without asbestos (NBR ・ EPDM ・ PTFE)

3. Item No.

Table 2 shows item No.

Size	Nut materials		
	Brass	Bronze	Stainless steel 304
1/2"	Z-101	Z-106	Z-101S
3/4"	Z-102	Z-107	Z-102S
1"	Z-103	Z-108	Z-103S
1-1/4"	Z-122	Z-123	Z-122S

4. Dimensions and maximum working pressure

Table 2 shows dimensions and maximum working pressure.

Table2. Dimensions and maximum working pressure

Unit : mm

Item No.	Size	Tube				Screw standard	Max. working pressure (MPa)
		ϕ A	ϕ B	ϕ d	Thickness		
Z-101	1/2"	12.9	19.5	14.0	0.3	1/2"PF	0.98
Z-106							
Z-101S							
Z-102	3/4"	17.8	25.0	19.0	0.3	3/4"PF	0.98
Z-107							
Z-102S							
Z-103	1"	23.8	32.0	25.0	0.3	1"PF	0.69
Z-108							
Z-103S							
Z-122	1-1/4"	28.9	38.0	30.0	0.3	1 1/4"PF	0.49
Z-123							
Z-122S							

※Maximum working pressure is at normal temperature.

5. Applicable temperature range

0℃~100℃

6. Minimum Bending Radius and bolt tightening torque (recommended value)

Table 4 shows minimum Bending Radius and bolt tightening torque

Table 4. Minimum Bending Radius and bolt tightening torque

Size	Min. Bending Radius (mm)	Tightening torque (N · m)
1/2"	45	19.6
3/4"	60	24.5
1"	75	29.4
1-1/4"	96	34.3

7. Gasket materials

Joint sheet without asbestos (Standard)、NBR、EPDM、PTFE

8. Option

- Wonder tube with protection tube

Figure 2 shows structure, table 5 shows material and feature.

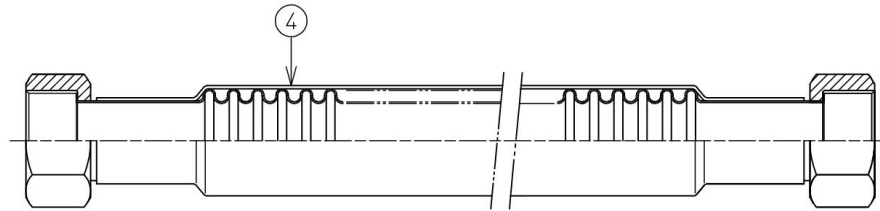


Figure 2. Structure

Table 5. shows material and feature

No.	Name	Material	Feature
4	Protection tube	EPDM	Prevents foreign matter from adhering to the outer surface of the tube.

9. Inspection

Inspection items : Visual inspection, Dimensional inspection (Overall length),
Leak inspection

Frequency : ALL

10. Notes

- Where the water hammer generate in the piping system, the flexible joint might be damaged.
Take appropriate impact prevention measures.
- Carry out the welding work of the piping before installing the flexible joint.
If you have to carry out the welding work after installing the flexible joint, take ground the welding electricity, also put a protective cover around the flexible joint so that the welding current does not flow into the piping system.
- Please select the pipe size not to exceed 3m/s of flow velocity.
- In case of corrosive fluid for stainless steel, ZTF series products (fluoro-resin bellows) are recommended.
- When tightening the nut, be careful not to twist the product.
- Please refer to the "Installation Instructions" for installation procedures.